



TEST CERTIFICATE

Sample Information:		
Sample : Earthing Backfill Compound	Report No. : 21011730/B	Job Code : STRC/21011730
Sample Description : Earthing Backfill Compound		Sample Received On : 01/03/2024
Party's Ref No. : Nil	Report Issue Date : 09/03/2024	Date of Testing : 01/03/2024 To 09/03/2024
Sample Condition : Packed Properly	:	Sample quantity : 2 Kg

TEST RESULTS

S.No.	Test Parameter	Test Result	Requirement as per IEC 62561-7	Test Method	Conformity
9	Corrosion Test (Ohm-m ²)	10.6	>8 (Ohm-m ²)	ASTM G59 (Clause-5.5 of IEC:62561-7)	Yes
Electrical Testing					
10	Electrical Resistivity (Ohm-mtr)	0.110	0.12 Max.	ASTM G 57 (Clause 5.4 of IEC:62561-7)	Yes

Decision Rule: The decision rule as per SOP DR01 is applied wherever statement of conformity to a specification or standard provided in the test report.


*****End of Report*****

21011730/B-2



Ravinder Cheema
Ravinder Cheema
Technical Manager

Shruti Vij
Shruti Vij
Technical Manager

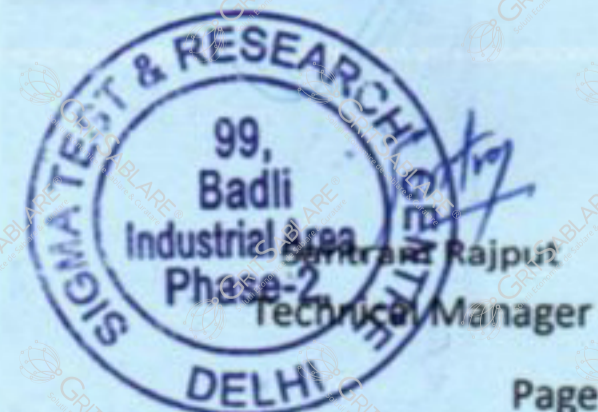

Page No.: 2 of 2

Format No.: STRC/7.8/F/TC/Z/02

Scan QR Code to verify the authenticity of Report

(1) The Test results listed refer only to tested samples and applicable parameters. Endorsement of product is neither inferred nor implied. (2) Total liability of our Lab is limited to the invoiced amount. (3) Sample(s) are retained for 7 days (in case of perishable items) and 30 days for non perishable samples or unless otherwise specified. (4) This Test Report is not to be reproduced wholly or in part and cannot be used as an evidence in the court of Law and should not be used in any advertising media without our special permission in writing. (5) The Test Report refer to the sample submitted to us and not drawn by Sigma Test & Research Centre unless mentioned otherwise.